

DESIGN NOTES:

1. CONCRETE 5,000 PSI @ 28 DAYS
2. REINFORCING ASTM A-615 GRADE
60 #5 REBAR 12" O.C.B.W. OR EQUAL
3. STRUCTURE DESIGNED FOR H-20 LOADING
WITH 18" TO 5' OF COVER
4. SEE CONDITIONS SHEET FOR PROPER SITE PREPARATION



120 CLAY PIT ROAD
MARSHFIELD, MA 02050
PHONE # 1-800-440-0009
FAX # 781-837-4320

CONTRACTOR:




JOB NAME:

DATE:

APPROVED BY:



DRAWING BY: C. J. SCOTT

14,000 GALLON SINGLE COMPARTMENT H-20 TANK

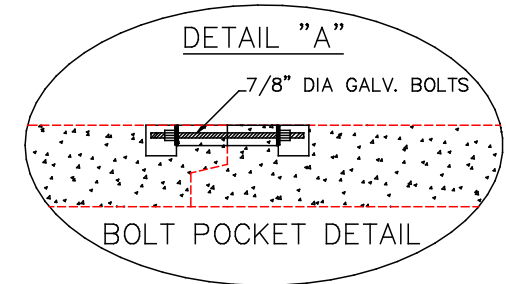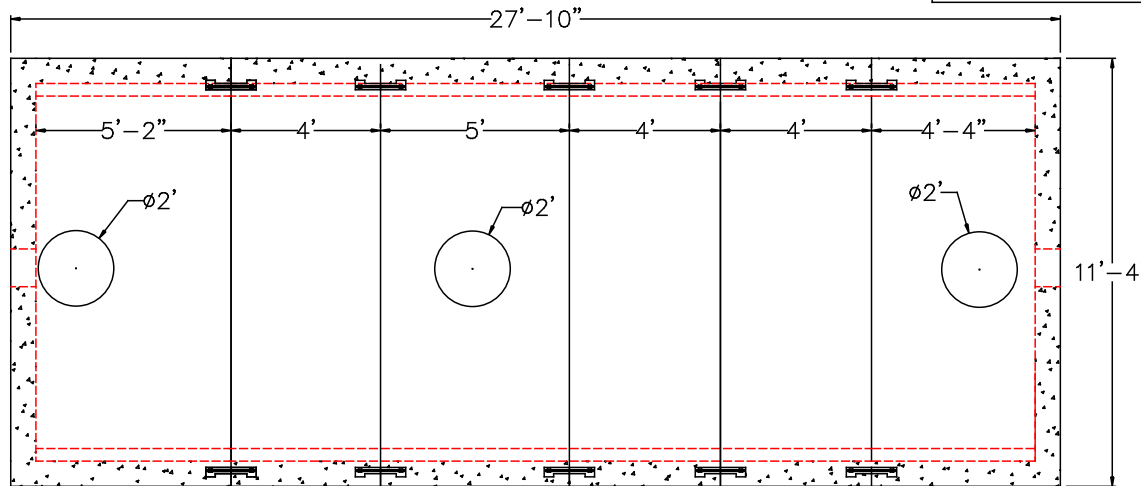

NPCA

Precast ... The Concrete Solution.

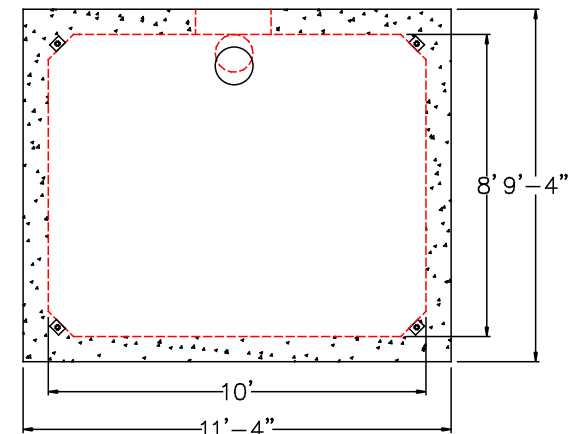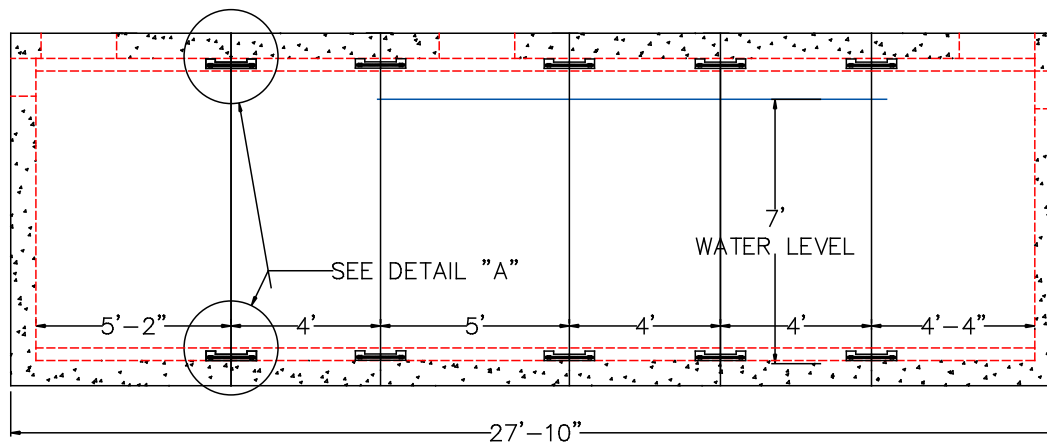

APPROVED FOR PRODUCTION BY _____

DATE _____