

- DESIGN NOTES:
1. CONCRETE 5,000 PSI @ 28 DAYS
 2. REINFORCING ASTM A-615 GRADE
60 #5 REBAR 12" O.C.B.W. OR EQUAL
 3. STRUCTURE DESIGNED FOR H-20 LOADING
 4. SEE ATTACHED CONDITIONS SHEET
 5. EXTERIOR TO HAVE BITUMINOUS COATING APPLIED



SCITUATE
COMPANIES

120 CLAY PIT ROAD
MARSHFIELD, MA 02050
PHONE # 1-800-440-0009
FAX # 781-837-4320

CONTRACTOR:

JOB NAME:



DATE:

APPROVED BY:

DRAWING BY:

C. J. SCOTT

25,000 GALLON TANK

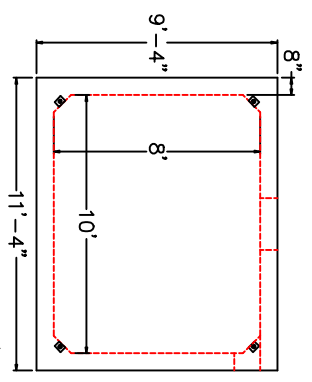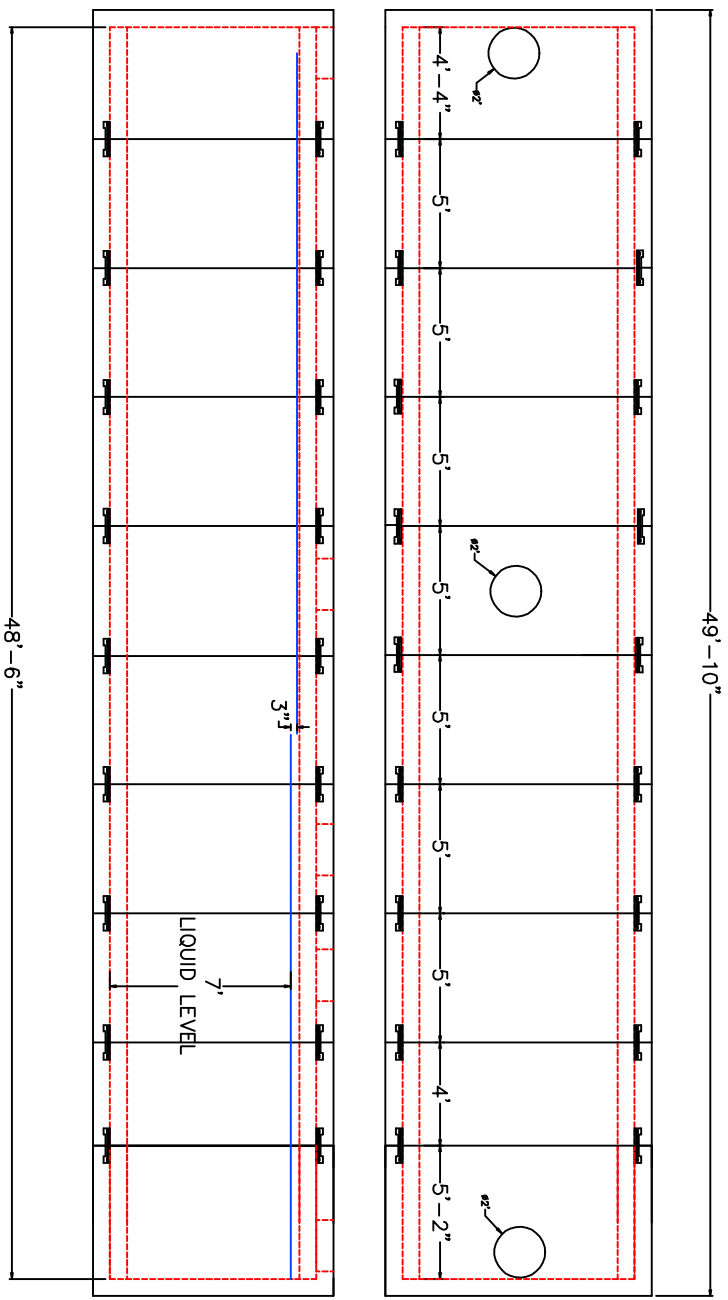

APPROVED FOR PRODUCTION BY _____ DATE _____